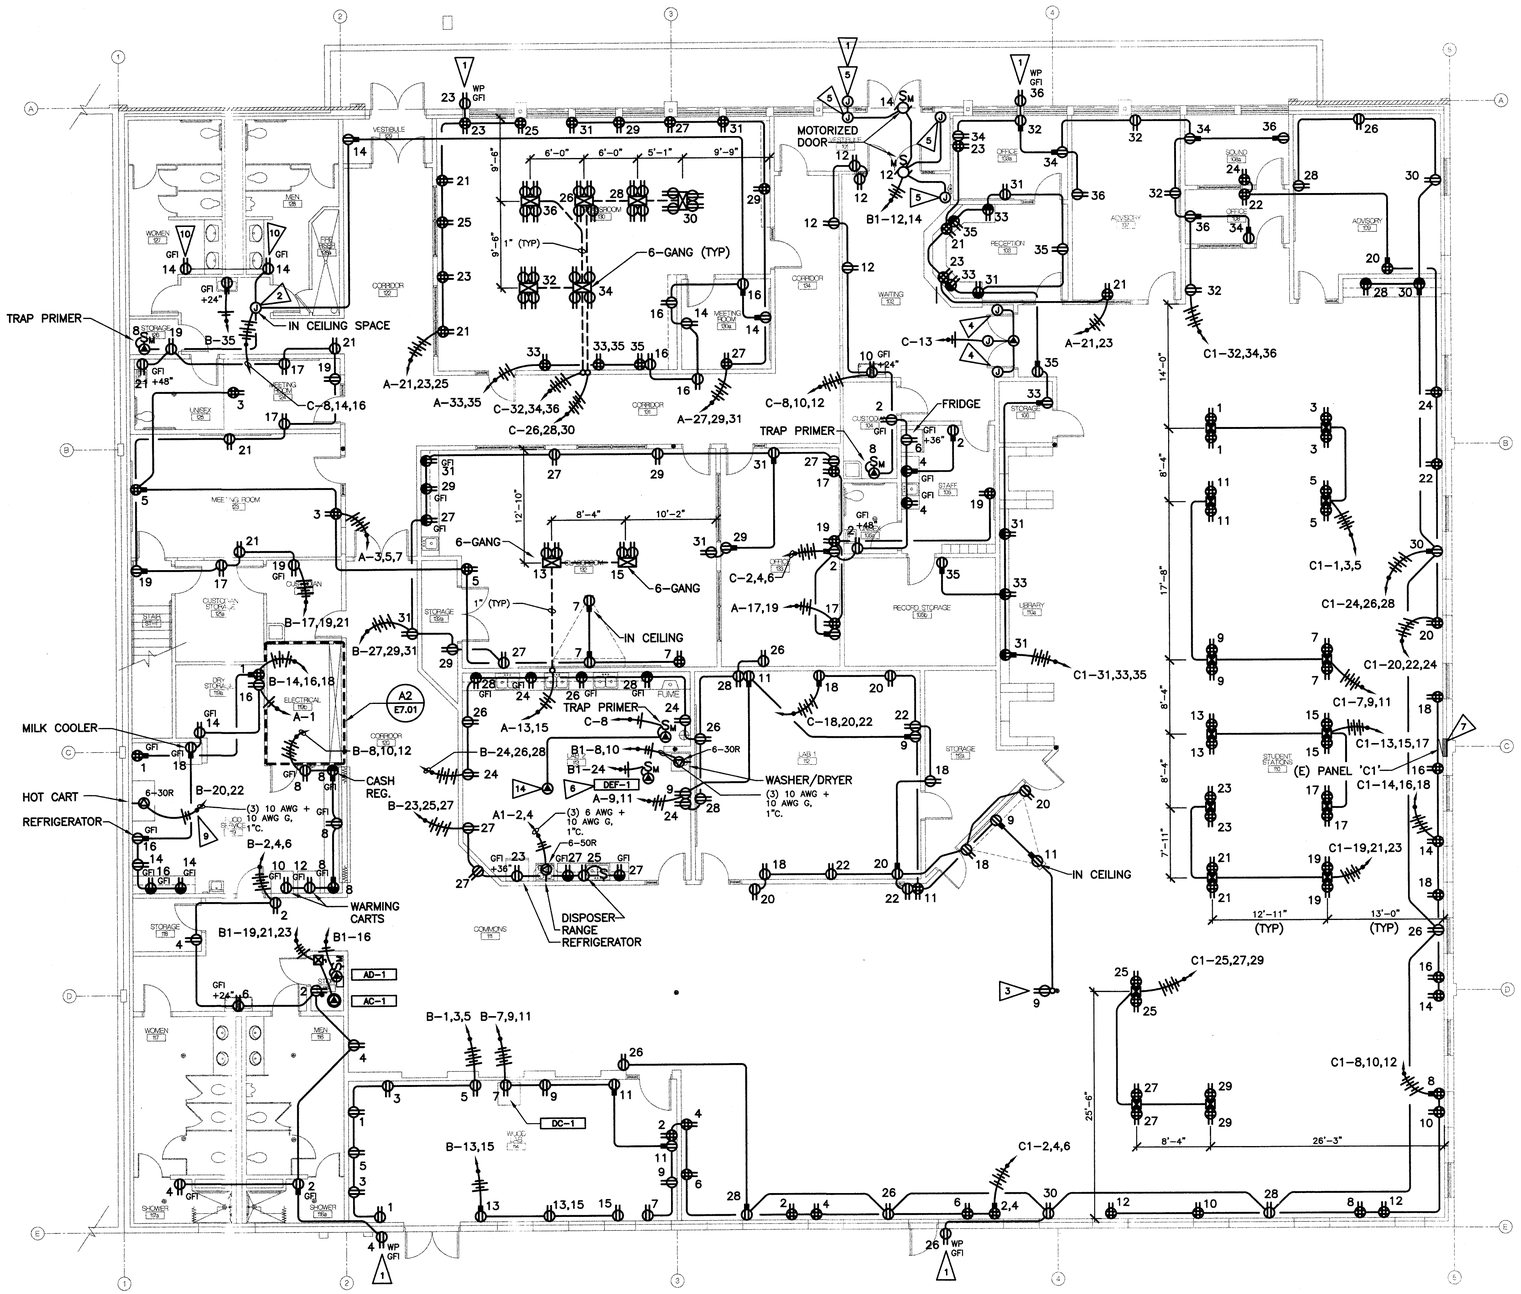

SHEET NOTES:

1. COORDINATE ALL EXTERIOR DEVICE LOCATIONS WITH LOCATION SHOWN ON ARCHITECTURAL EXTERIOR ELEVATIONS. WHERE CONFLICT OCCURS, ARCHITECTURAL ELEVATIONS TAKE PRECEDENCE.
2. COORDINATE ALL CEILING MOUNTED DEVICE LOCATIONS WITH ARCHITECTURAL REFLECTED CEILING PLANS. WHERE CONFLICT OCCURS, ARCHITECTURAL R.C.P. TAKES PRECEDENCE EXCEPT WHEN LOCATION IS MODIFIED BY CODE AUTHORITY.
3. WALL MOUNTED DEVICES SHALL NOT BE MOUNTED BACK TO BACK UNLESS PHYSICAL SPACE NECESSITATES IT. IF THESE DEVICES MUST BE MOUNTED BACK TO BACK, PROVIDE SOUND INSULATION IN BOXES.
4. FINAL LOCATION OF EQUIPMENT DISCONNECTS/ CONTROLLERS SHALL BE COORDINATED WITH ALL TRADES PRIOR TO ROUGH-IN. NEC REQUIRED CLEARANCES SHALL BE MAINTAINED. A UNISTRUT ASSEMBLY SHALL BE CONSTRUCTED FOR ALL DISCONNECTS/ CONTROLLERS WHICH CAN NOT BE LOCATED ON BUILDING STRUCTURE. PROVIDE ALL MATERIALS AS REQUIRED.
5. SEE MECHANICAL EQUIPMENT SCHEDULES ON SHEET E0.03 FOR ADDITIONAL INFORMATION.
6. ALL DEVICES SHALL BE INSTALLED RECESSED IN NEW AND EXISTING WALLS UNLESS OTHERWISE NOTED. EXISTING WALLS WILL REQUIRE EXISTING SWATHS OF SHEETROCK TO BE CUT TO ACCOMMODATE CONCEALED ROUTING OF RACEWAY. COORDINATE CUTTING AND PATCHING WITH ARCHITECTURAL DRAWINGS.
7. SEAL ALL EXTERIOR WALL PENETRATIONS WITH APPROVED FIRE PROOFING MATERIALS.

FLAG NOTES:

1. PROVIDE SURFACE MOUNTED NEMA-3R J-BOX FOR DEVICE AS INDICATED. PENETRATE EXTERIOR WALL AND ROUTE CONDUIT OUT OF BACK OF BOX, CONCEALED WITHIN WALL. SEAL EXTERIOR PENETRATION WITH FIRE PROOFING MATERIALS.
2. INTERCEPT EXISTING CIRCUITING SERVING EXISTING DEVICES INDICATED AND CIRCUIT AS INDICATED. FIELD VERIFY EXISTING CIRCUIT CONDUCTOR COLOR. PROVIDE NEW CONDUCTORS AS REQUIRED TO MAINTAIN COLOR FOR NEW CIRCUITING AS INDICATED.
3. PROVIDE DEVICE IN SMR BOX WITH V700 SMR ROUTED UP POLE TO ACCESSIBLE CEILING SPACE. TRANSITION TO CONDUIT IN CEILING SPACE AND ROUTE AS INDICATED.
4. PROVIDE CONNECTION FOR ELECTRIC DOOR HOLD OPEN DEVICE. COORDINATE LOCATION AND ELEVATION PRIOR TO ROUGH-IN.
5. DOOR CONTROL STATION(S). COORDINATE LOCATION WITH A/E PRIOR TO ROUGH-IN.
6. DEF-1 IS LOCATED IN CEILING SPACE ABOVE WASHER/ DRYER.
7. PROVIDE NEW HOMERUN ROUTING INTO EXISTING FLUSH MOUNTED PANEL. UTILIZE EXISTING SPARE CONDUITS AS ABLE. COORDINATE CUTTING AND PATCHING OF WALL TO ROUTE CONCEALED CONDUITS TO PANEL WHERE ADDITIONAL CONDUITS ARE REQUIRED.
8. EXISTING RECEPTACLES IN THIS ROOM ARE CIRCUITED TO (6) CIRCUITS IN PANEL 'C2'. FIELD VERIFY EXISTING CIRCUITING TO EACH DEVICE AND INCLUDE REDLINES IN AS-BUILT RECORD DRAWINGS. EXISTING LOADS FOR EXISTING RECEPTACLES ARE INDICATED ON PANEL 'C2' SCHEDULE.
9. ROUTE HOMERUN CONCEALED UP WALL AND INTO MEZZANINE. ROUTE THROUGH MEZZANINE AND DOWN INTO ELECTRICAL ROOM TO PANEL AS INDICATED.
10. PROVIDE NEW DEVICE IN EXISTING RECESSED ROUGH-IN.
11. PROVIDE 120VAC TO 24VDC LOW VOLTAGE TRANSFORMER RIB #PSMN40A24DS OR APPROVED FOR GAS SOLENOID. PROVIDE ENCLOSURE SIZED TO ACCOMMODATE TRANSFORMER MOUNTED IN CEILING SPACE ADJACENT SOLENOID VALVE. PROVIDE CONDUIT AND CONNECTIONS BETWEEN TRANSFORMER, SOLENOID VALVE AND GAS SHUT-OFF SWITCH FURNISHED AND INSTALLED BY DIVISION 23. COORDINATE WITH PLUMBING CONTRACTOR PRIOR TO ROUGH-IN.
12. PROVIDE 120VAC TO 24VDC LOW VOLTAGE TRANSFORMER RIB #PSMN40A24DS OR APPROVED FOR GAS SOLENOID. PROVIDE ENCLOSURE SIZED TO ACCOMMODATE TRANSFORMER MOUNTED IN CEILING SPACE

A1 FIRST FLOOR POWER FLOOR PLANS
SCALE: 1/8" = 1'-0"

A8 MEZZANINE POWER FLOOR PLANS
SCALE: 1/8" = 1'-0"

RICHARD L. BORGMAN
STATE OF WASHINGTON
21701
REGISTERED PROFESSIONAL ENGINEER
1/10/2013

DESIGN WEST
ARCHITECTS, P.A.
7513 W. KENNEWICK AVE. SUITE D
KENNEWICK, WA. 99336
PH. (509) 783-2244 FAX (509) 783-8740

© COPYRIGHT DESIGN WEST ARCHITECTS P.A.
DESIGN CONCEPTS AND DRAWINGS NOT TO BE REUSED WITHOUT WRITTEN PERMISSION OF ARCHITECT

HARGIS
Hargis Engineers, Inc.
800 Stewart Street, Suite 1000 | Seattle, WA 98101
t | 206.448.3376 f | 206.448.4450 w | hargis.biz
ENGINEERS | MECHANICAL ELECTRICAL TELECOMMUNICATIONS

KENNEWICK SCHOOL DISTRICT
1315 BUILDING RENOVATIONS
1315 WEST 4TH AVENUE
KENNEWICK, WA.
99336

REVISIONS
DRAWN BY: JPH, DB
CHECKED BY: MLR
DATE 12/19/2012
JOB NUMBER 1278
SHEET NAME: FIRST FLOOR AND MEZZANINE POWER FLOOR PLANS
SHEET **E3.01**